
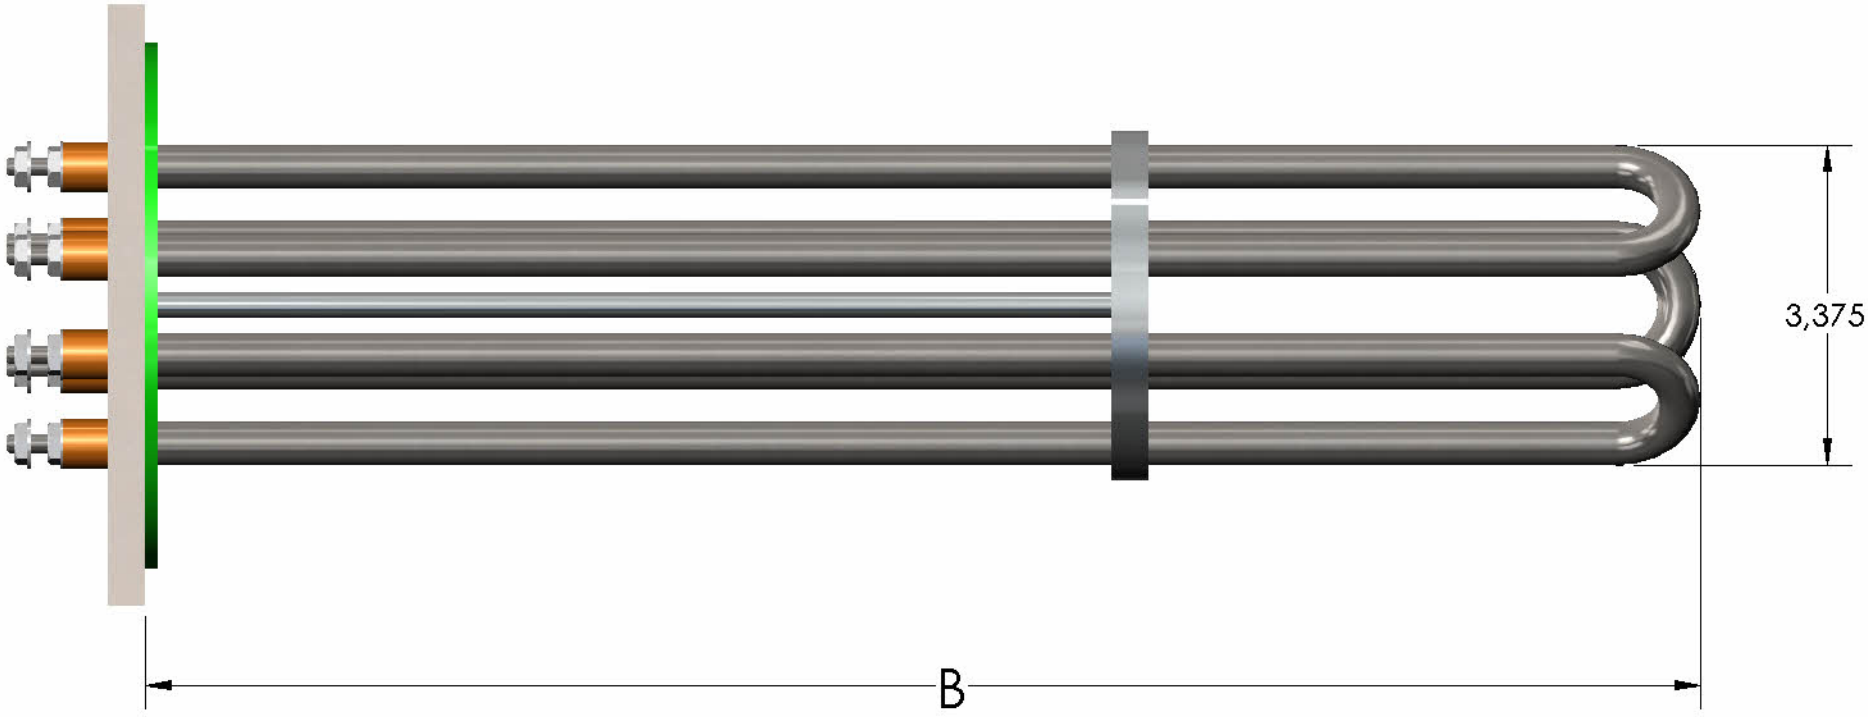
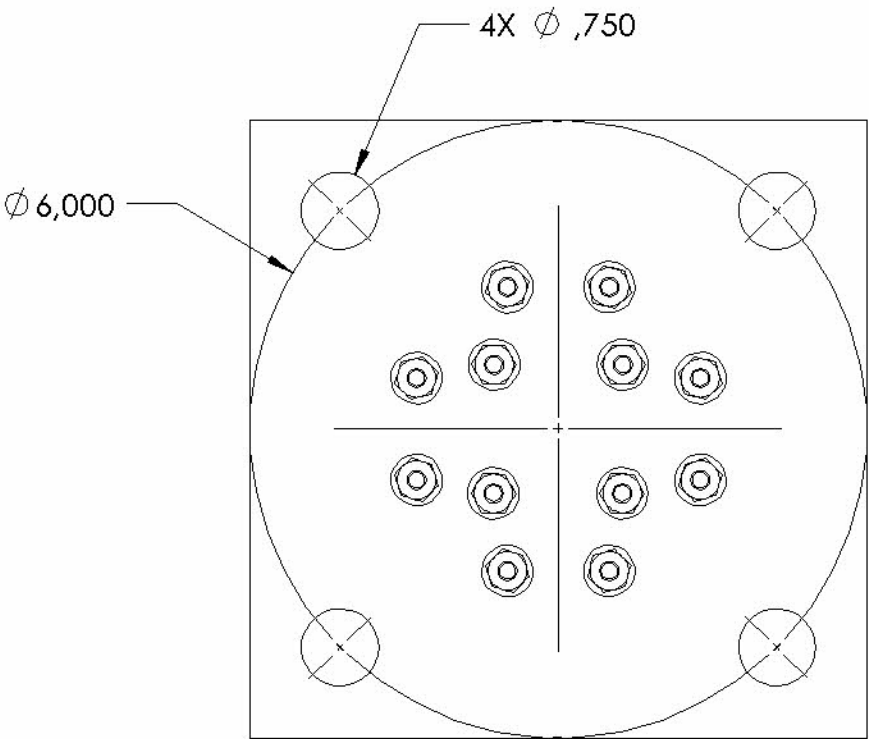


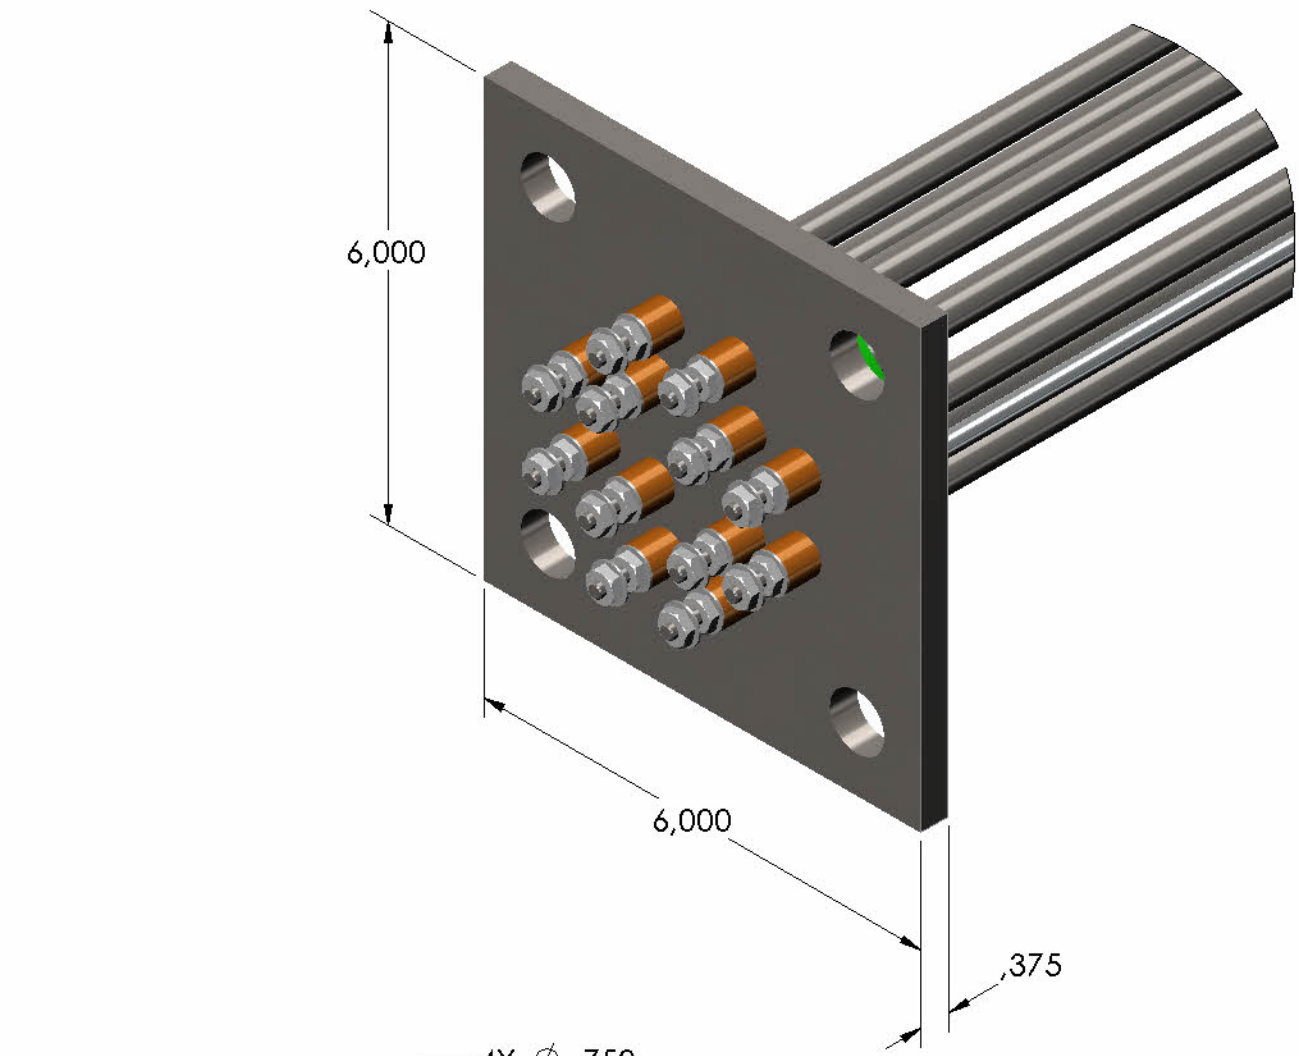

NOTES:

1. INCOLOY ELEMENTS OF .430 DIAMETER
2. ALL HEATER SUPPLIED WITH GASKET
3. PRESSURE (150 PSI), DIELECTRIC, AND RESISTANCE TEST ON ALL HEATERS
4. TERMINAL BOX OPTIONAL

ITEM NO.	DIM. FLANGE	B	VOLT	WATT	PH	TUBULAR
IM-0002	6" X 6"	15.5	208	9	3	6
IM-0002A	6" X 6"	15.5	230	9	3	6
IM-0002B	6" X 6"	15.5	460 / 480	9	3	6
IM-0002C	6" X 6"	15.5	575	9	3	6
IM-0002D	6" X 6"	15.5	208	10.5	3	6
IM-0002E	6" X 6"	15.5	230	10.5	3	6
IM-0002F	6" X 6"	15.5	460 / 480	10.5	3	6
IM-0002G	6" X 6"	15.5	575	10.5	3	6
IM-0002H	6" X 6"	15.5	208	12	3	6
IM-0002I	6" X 6"	15.5	230	12	3	6
IM-0002J	6" X 6"	15.5	460 / 480	12	3	6
IM-0002K	6" X 6"	15.5	575	12	3	6
IM-0002L	6" X 6"	15.5	208	15	3	6
IM-0002M	6" X 6"	15.5	230	15	3	6
IM-0002N	6" X 6"	15.5	460 / 480	15	3	6
IM-0002O	6" X 6"	15.5	575	15	3	6
IM-0002P	6" X 6"	15.5	208	18	3	6
IM-0002Q	6" X 6"	15.5	230	18	3	6
IM-0002R	6" X 6"	15.5	460 / 480	18	3	6
IM-0002S	6" X 6"	15.5	575	18	3	6